



Mesures Canada

NOTICE OF APPROVAL

Issued by statutory authority of the Minister of Industry for:

TYPE OF DEVICE

Instrument Transformer: Voltage

AVIS D'APPROBATION

Émis en vertu du pouvoir statutaire du ministre de l'Industrie pour:

TYPE D'APPAREIL

Transformateur de mesure: tension

APPLICANT

REQUÉRANT

Ritz Instrument Transformers Inc.,
25 Hamburg Ave.,
Lavonia, Georgia,
30553
USA

MANUFACTURER

FABRICANT

Ritz Instrument Transformers Inc.,
25 Hamburg Ave.,
Lavonia, Georgia,
30553
USA

MODEL(S)/MODÈLE(S)

RATING/ CLASSEMENT

DVE-6

Accuracy class / Classe de précision:	0.3W, 0.6X
Rating Factor / Facteur du surcharge:	1.1Un
Thermal Burden / Fardeau Thermique:	300 VA
Frequency / Fréquence:	60 Hz
Voltage class / Catégorie de tension:	0.72 kV

NOTE: This approval applies only to meters, the design, composition, construction and performance of which are, in every material respect, identical to that described in the material submitted, and that are typified by samples submitted by the applicant for evaluation for approval in accordance with sections 13 and 14 of the Electricity and Gas Inspection Regulations. The following is a summary of the principal features only.

SUMMARY DESCRIPTION:

The DVE-6 is a voltage transformer molded in epoxy resin. It is suitable for both indoor and outdoor use.

RATIO / TAP

The following ratios are approved for revenue metering:

Ratio Rapport	Tap Enroulement	Accuracy class Classe de précision	Thermal Burden Fardeau thermique
120/208Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
240/416Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
288/500Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
300/520Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
480/480Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
600/600Y-120V	X ₁ -X ₂	0.3W 0.6X	300 VA
360-120V	X ₁ -X ₂	0.3W 0.6X	300 VA

EVALUATED BY

Ray Kandalaft,
Legal Metrologist

Michael Rozeboom, Rev 1
Legal Metrologist

ÉVALUÉ PAR

Ray Kandalaft,
Métrologiste légal

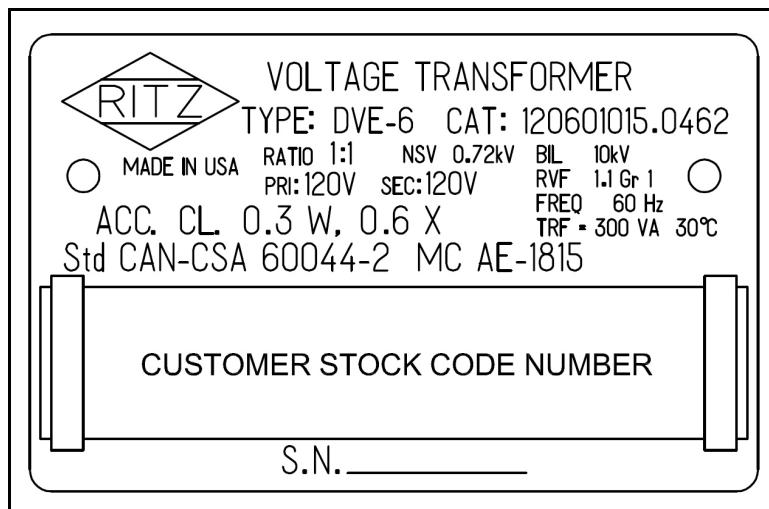
Michael Rozeboom, Rev 1
Métrologiste légal

REVISION**Original****Issued Date: 2011-06-13****Rev. 1**

The purpose of revision 1 is to include the voltage ratio 360-120V 0.3W 0.6X.

RÉVISION**Originale****Date d'émission: 2011-06-13****Rév. 1**

La révision 1 vise à inclure le rapport de tension 360-120V 0.3W 0.6X.

NAMEPLATES AND MARKINGS**PLAQUES SIGNALÉTIQUES ET MARQUAGE**

APPROVAL:

The design, composition, construction and performance of the meter type(s) identified herein have been evaluated in accordance with regulations and specifications established under the *Electricity and Gas Inspection Act*. Approval is hereby granted accordingly pursuant to subsection 9(4) of the said Act.

The sealing, marking, installation, use and manner of use of meters are subject to inspection in accordance with regulations and specifications established under the *Electricity and Gas Inspection Act*. The sealing and marking requirements are set forth in specifications established pursuant to section 18 of the Electricity and Gas Inspection Regulations. Installation and use requirements are set forth in specifications established pursuant to section 12 of the Regulations. Verification of conformity is required in addition to this approval for all metering devices excepting instrument transformers. Inquiries regarding inspection and verification should be addressed to the local office of Measurement Canada.

APPROBATION :

La conception, la composition, la construction et le rendement du(des) type(s) de compteur(s) identifié(s) ci-dessus, ayant fait l'objet d'une évaluation conformément au Règlement et aux prescriptions établis aux termes de la *Loi sur l'inspection de l'électricité et du gaz*, la présente approbation est accordée en application du paragraphe 9(4) de ladite Loi.

Le scellage, l'installation, le marquage, et l'utilisation des compteurs sont soumis à l'inspection conformément au Règlement et aux prescriptions établis aux termes de la *Loi sur l'inspection de l'électricité et du gaz*. Les exigences de scellage et de marquage sont définies dans les prescriptions établies en vertu de l'article 18 du Règlement sur l'inspection de l'électricité et du gaz. Les exigences d'installation et d'utilisation sont définies dans les prescriptions établies en vertu de l'article 12 dudit règlement. En plus de cette approbation et sauf dans les cas des transformateurs de mesure, une vérification de conformité est requise. Toute question sur l'inspection et la vérification de conformité doit être adressée au bureau local de Mesures Canada.

Original copy signed by:

Adnan Rashid
Senior Engineer – Electricity Measurement
Engineering and Laboratory Services Directorate

Copie authentique signée par:

Adnan Rashid
Ingénieur principal – Mesure de l'électricité
Direction de l'ingénierie et des services de laboratoire

Date: **2011-11-29**

Web Site Address / Adresse du site Internet:
<http://mc.ic.gc.ca>