

N.R.C.70
Electricity

DEPARTMENT OF TRADE AND COMMERCE
ELECTRICITY AND GAS INSPECTION SERVICES

OTTAWA, may.17th, 1935.

District Inspectors of Electricity & Gas:

Dear Sirs,-

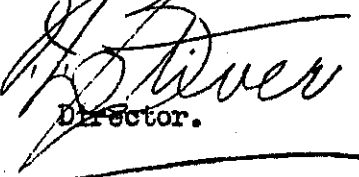
I beg to advise you that the single phase, 2 wire, 60 cycle, type EM, watt-hour meter manufactured by Chamberlain & Hookham Company, Birmingham, England, and sold in Canada by Fraser & Chalmers of Canada, Limited, Montreal, has been approved by the National Research Council for use in Canada in the following capacities:

Amperes - 10, 15, 25 and 50.
Voltage - 115, 230, 460 and 575.

We have asked the Company to use fractions in marking the disc constant on the nameplate of the meter. In the sample submitted to the Laboratory for test, which was a 10 ampere, 220 volt, 2 wire meter, the constant was given as 1.66. We have asked that a constant of this nature be marked as $1 \frac{2}{3}$.

Please note that these are all 2 wire meters.

Yours truly,


Director.