

DEPARTMENT OF TRADE AND COMMERCE  
ELECTRICITY AND GAS INSPECTION SERVICES

OTTAWA, June 29, 1936.

TO DISTRICT INSPECTORS OF  
ELECTRICITY AND GAS.

RE: Approval New Type of Cover for  
Sangamo Type S-3, Single Phase,  
Watt-hour Meter.

Dear Sirs:

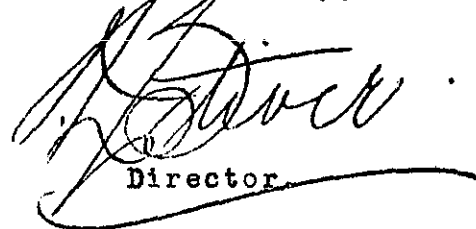
On January 26th, 1935, a new type of glass cover for the Sangamo Type S-3 single phase meter was approved by the National Research Council for use in Canada (Circular N.R.C. 67).

A few meters have been built using this form of cover but it has been found that the sealing bar interferes with the terminal box and makes it difficult for the installer to connect the meter in service. It is also dangerous when an installer has to connect or disconnect the meter on live circuits.

In order to overcome this trouble, the Sangamo Company has simply reversed the cover and has placed the sealing bar across the top of the meter rather than over the terminal box. In all other respects, the meter and cover remain the same.

This is to inform you that the National Research Council has approved of this new type of cover for use on the Sangamo type S-3, single phase watt-hour meter.

Yours truly,

  
Director

JLS/MEE