

DEPARTMENT OF TRADE AND COMMERCE
ELECTRICITY AND GAS INSPECTION SERVICES

OTTAWA, November 22, 1938.

TO DISTRICT INSPECTORS OF
ELECTRICITY AND GAS

Re: Approval of General Electric
Types DG-1 and DG-2 Polyphase
Watt-hour Demand Meters.

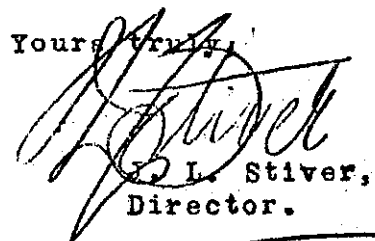
Dear Sirs:

This is to advise you that the types DG-1 and DG-2 polyphase watt-hour demand meters, manufactured by the General Electric Company, have been approved by the National Research Council for use in Canada in the following capacities:

Amperes: 2.5 for use with current transformers;
Voltage: 115, 230, 460, 575;
Frequency: 25 and 60 cycle;
Time Interval: 15, 30 and 60 minute.

These meters combine in one device a watt-hour meter and a recording demand meter. The demand mechanism is of the "block-interval" type, recording on a strip-chart the demand over a definite time interval. The type DG-1 is a two-element demand meter and the type DG-2 is a three-element demand meter.

Yours truly,


J. L. Stiver,
Director.

JLS/mee