

TRADE AND COMMERCE
CANADA

SD-EA.90

STANDARDS DIVISION

OTTAWA, December 15, 1952.

MODIFICATION OF TYPE APPROVALSANGAMO TYPE "SC" THERMAL GRAPHIC DEMAND WATTMETER


The modification to the apparatus specified and illustrated herein has been duly approved by the Standards Division under the provisions of The Electricity Inspection Act, Chapter 22, 1928, as amended, and the modified apparatus may be admitted to verification in Canada.

Apparatus Modified: Type "SC" Thermal Strip Chart Graphic Demand Wattmeter, manufactured by the Sangamo Company Limited, Leaside, Toronto 17, Canada.

Rating of Apparatus: The modification is approved for all the presently approved capacities, both 2- and 3-element. The meter itself was approved under the following circulars:-

NRC-18 of May, 1931
NRC-29 of May, 1932
NRC-95 of April, 1937
NRC-130 of September, 1939.

Description: The modification concerns only the enclosure and the mounting, and not the meter itself. In this arrangement the meter is mounted on a plate hinged in such a way that it can be drawn out for inspection. It is secured in place by a lever at the top of the case which must be pressed to the side to release. When swung out, the hinged section is locked out by the same lever. The mounting plate is free to pivot and is locked in one position, for inspection or service, by the knurled head pin.

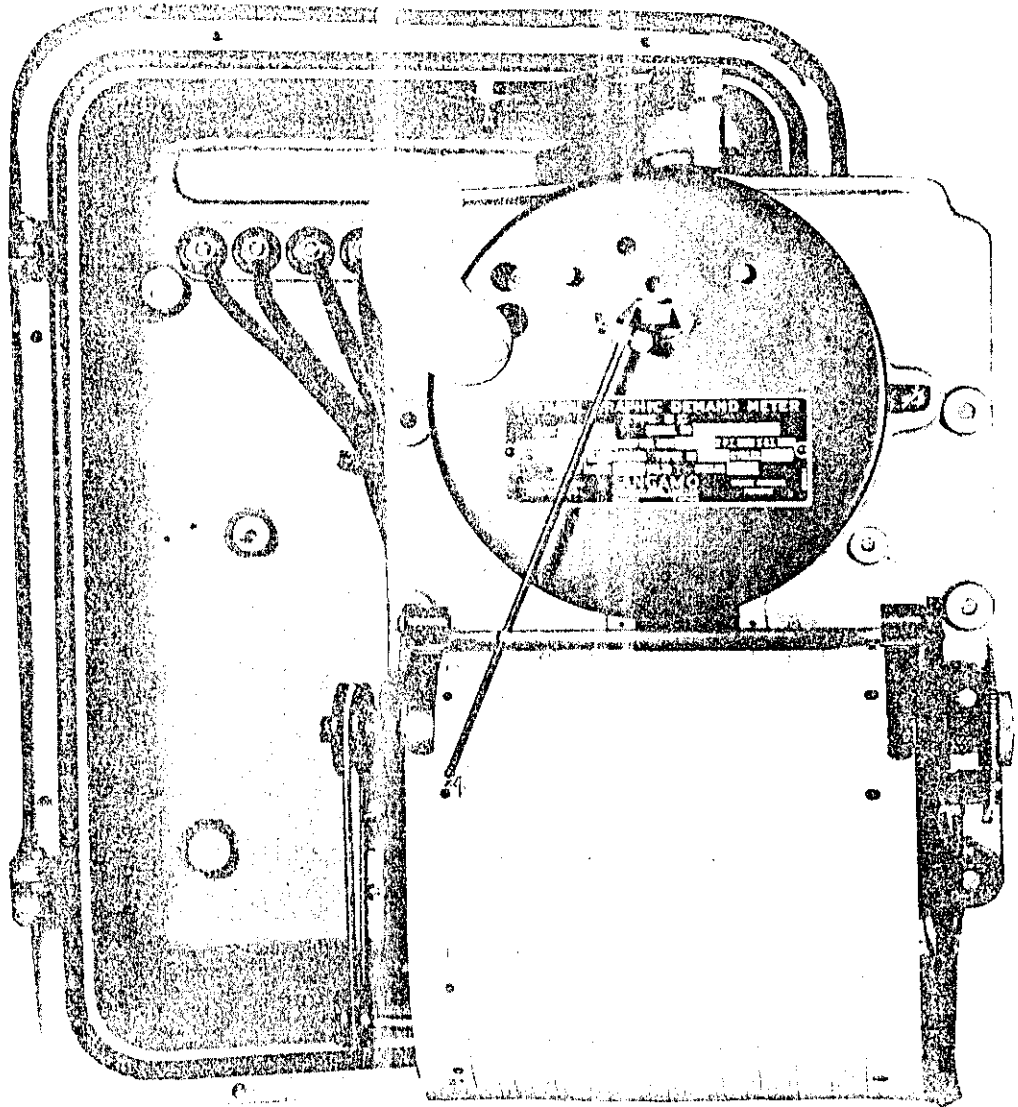

R. W. MacLean,
Director,
Standards Division.

E. F. Power

E. F. Power,
Assistant Director (E&G),
Standards Division.

Ref: A-288

SANGAMO TYPE "NO" THERMAL GRAPHIC DEMAND METER





11