

TRADE AND COMMERCE  
CANADA

STANDARDS BRANCH

OTTAWA August 28, 1959.

TYPE APPROVALSANGAMO TYPE "MV-6" 3-WIRE CURRENT TRANSFORMER

The apparatus specified and illustrated herein has been duly approved by the Standards Branch under the provisions of the Electricity Inspection Act, Chapter 94, R.S. 1952, and may be admitted to verification in Canada.

Apparatus Approved: Type "MV-6" 3-Wire Current Transformer, manufactured by the Sangamo Company Limited, Leaside, Toronto 17, Ontario.

## Rating of Apparatus:

Primary Currents ..... 600 and 800 amperes  
 Secondary Current ..... 5 amperes  
 Accuracy Rating ..... 0.3B0.1, 0.3B0.2\*, 0.6B0.5  
 Rated Voltage ..... 0.6 KV  
 Wire ..... 3  
 Frequency ..... 60 cycles  
 Style ..... Indoor type.


\*Accuracy stamped on nameplate.

Description: The above two ratios complete the line of this type of transformer. The lower ratios were previously approved under Circular SD-EA.383, December 15, 1958.


E. F. Power,  
 Assistant Director (E&G),  
 Standards Branch.

R. W. MacLean,  
 Director,  
 Standards Branch.


Ref: A756C



SANGAMO TYPE "MV-6" 3-WIRE CURRENT TRANSFORMER

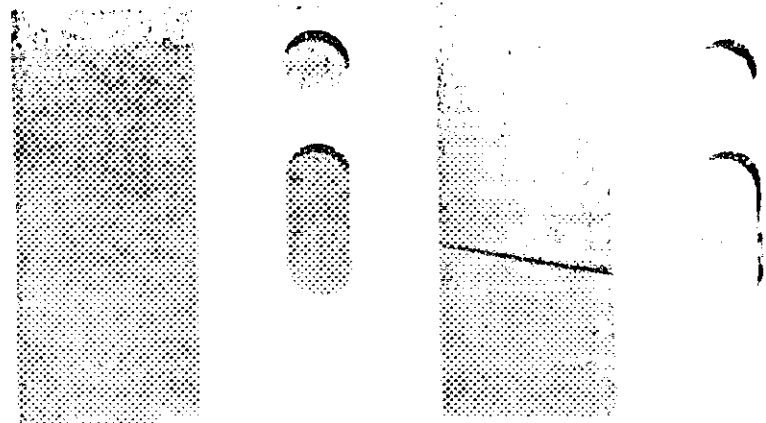

TYPE		CURRENT TRANSFORMER	
SEA NO.		CYCLE	
WIND		AMPER	WIRE
COMPACT		WINDING	K.V.
ACCURACY			
AT 60°C			
CONT. LOADING FACTOR			
DATA SHEET			
SANGAMO			

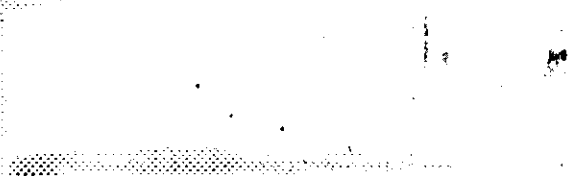

600

