

October 28, 1976

Your file Votre référence

Our file Notre référence

G6565-F2-32

SPECIAL APPROVAL

Granted to: Ferranti-Packard Limited,
Dieppe Road,
St. Catharines, Ontario.
L2R 6W9


Attention: Mr. B. O'Connell

Subject: Six only Ferranti-Packard Type K35
Current Transformers, 300x600-5 amperes,
60 Hz. Serial Nos. 2-422852 to 2-422857
inclusive.

Special Approval has been granted by the Standards Directorate for use of the subject transformers for billing purposes in Canada.

The type K35 transformers were approved under T-14, 1966 with a nameplate accuracy rating of 0.3B0.5 or 0.3B0.9. They met the requirements, however, for 0.3B2.0, and permission is herewith granted to mark these six with an accuracy rating of 0.3B2.0 on the nameplate.

They are to be used by the Gull Island Power Company Ltd. at Happy Valley Substation, Goose Bay, Labrador. The customer is Power Distribution District of Labrador.

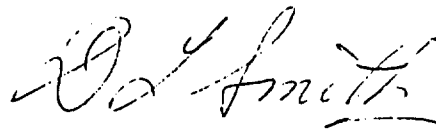

D.L. Smith,
Chief,
Electricity and Gas Division

c.c. Mr. J. Strachan, D.I. of E&G, St. John's Nfld.
Gull Island Power Co. Ltd. (through Mr. Strachan)