



DEPARTMENT OF TRADE AND COMMERCE
STANDARDS BRANCH

E-62

OTTAWA December 8, 1967

NOTICE OF APPROVAL

FOR

LANDIS & GYR TYPE "MFP7" POLYPHASE WATTHOUR METER

Apparatus

Current Range	0.12 - 10 amperes
Voltage	115, 120, 230, 240 volts
Elements	3
Circuit	3-phase 4-wire Y
Frequency	60 hz
Watthour Constant(Kh)	2.0 (at 115-120 volts)

Description

The type MFP7 polyphase watthour meter is intended for use with instrument transformers for the measurement of large loads. Each of the 3-elements is identical to those used in the 2-element "FFP7" receiving approval under SD-EA.245 and SD-EA.388.

The type MFP7 is approved with a clock register only but may be supplied with any suitable, approved Landis & Gyr attachments, which when installed, will be indicated in the type designation.


Approval granted to:

Landis & Gyr Inc.,
725 Decarie Blvd.,
St. Laurent 9, Quebec.

J. S. T. Swanson
J. S. T. Swanson,
Chief, Standards Laboratory,
Standards Branch.

W. J. S. Fraser
W. J. S. Fraser,
Chief, Electricity & Gas Division,
Standards Branch.

Reference SL-100-681AL

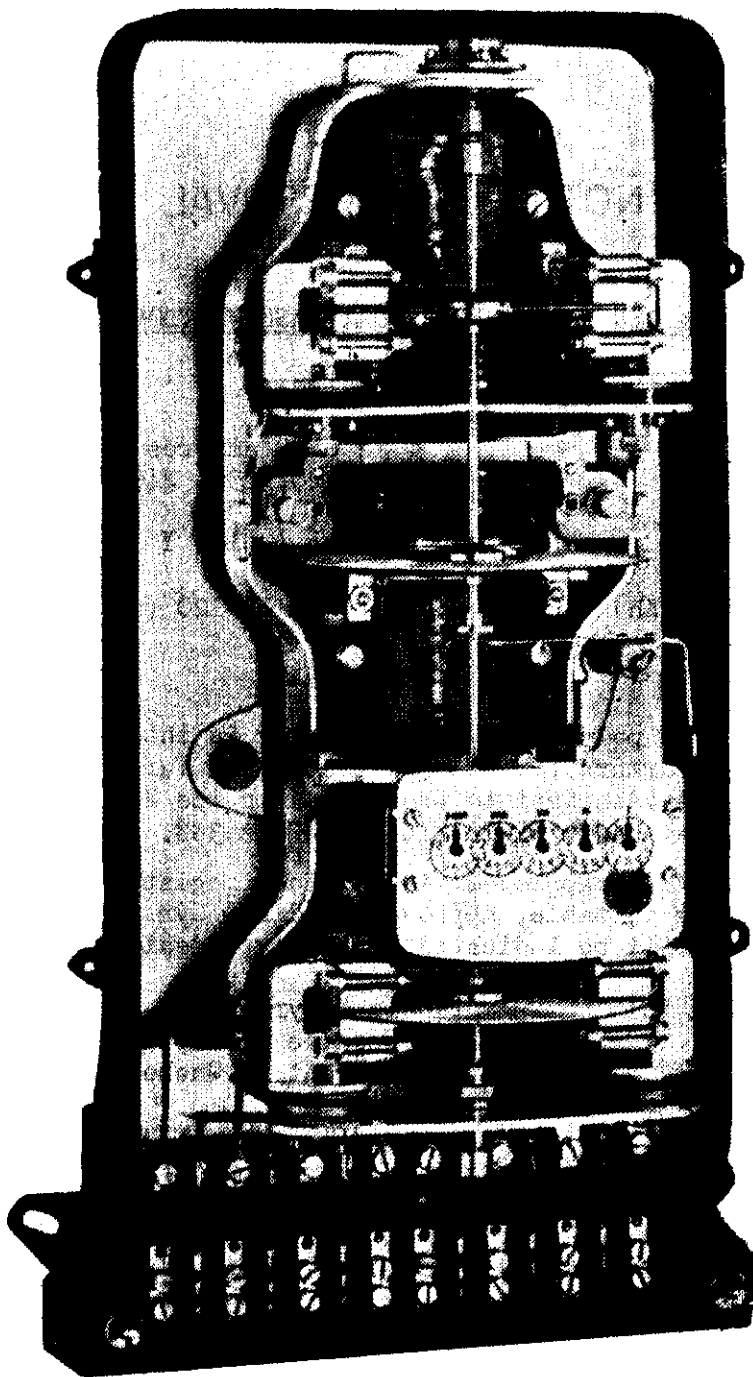

Type MFP7