

DEPARTMENT OF TRADE AND COMMERCE

ELECTRICAL AND GAS STANDARDS LABORATORIES

Ottawa, September 20th, 1930.

District Inspectors of Electricity & Gas:-

Dear Sirs,- I beg to advise you that the two element vertical polyphase type H.C. watt-hour meter, manufactured by the Sangamo Electric Company of Canada, Toronto, Ontario, has been approved by the National Research Council and may be admitted to verification in Canada.


This meter may be supplied in the following capacities:-

5, 10, 25 and 60 amperes, and 115, 230, 460 and 575 volts for frequencies of 25, 30 and 60 cycles.

It is built for use on 3 phase, 3 wire circuits; 2 phase, 4 wire circuits and also can be used in connection with current transformers on 4 wire, 3 phase circuits.

This meter may be supplied with either side or bottom connections.

Yours truly,

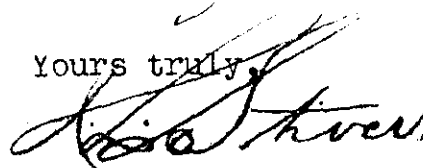

Director.