

DEPARTMENT OF TRADE AND COMMERCE

Electrical and Gas Standards Laboratories

Ottawa, March 4th, 1931.

District Inspectors of Electricity & Gas:


Dear Sirs,- I beg to advise you that the type ED.3 Lincoln Demand Energy Meter, manufactured by the Sangamo Electric Company, Ltd., Toronto, Canada, has been approved by the National Research Council and may be admitted to verification in Canada.

This meter is similar to the present ED meter approved some time ago, but incorporates the following:-

1. The new Lincoln Bakelite element.
2. The type S.3 single phase watt-hour element.

The capacities and ratings for the type ED.3 meter will be as follows; 5, 10, 15, 25, 50 and 100 amperes; 115, 230, 460 and 575 volts; and 25 to 60 cycles. It will be supplied in either two or three wire single phase type.

Yours truly

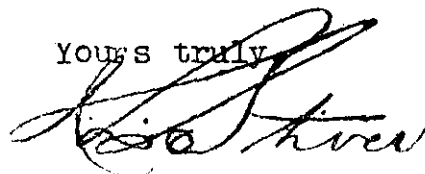

Director.