

DEPARTMENT OF TRADE AND COMMERCE

Electrical and Gas Standards Laboratories


Ottawa, April 8th, 1931.

District Inspectors of Electricity & Gas:-

Dear Sirs,- I beg to advise you that the type S.3 horizontal polyphase watt-hour meter, manufactured by the Sangamo Company, Limited, Toronto, Canada, has been approved by the National Research Council and may be admitted to verification in Canada.

The type S.3 meter will be built in the following current capacities; 5, 10, 15, 25 and 50 amperes; and voltages of standard rating, 115, 230, 460 and 575; and in frequencies of 25, 30 and 60 cycles. It will be built in 3 and 2 phase, 3 or 4 wire construction.

Yours truly,

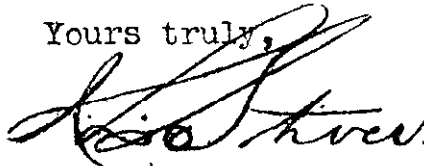

Director.