

N.R.C. 101
Electricity.

DEPARTMENT OF TRADE AND COMMERCE
ELECTRICITY AND GAS INSPECTION SERVICES

OTTAWA, Sept. 14, 1937.

TO DISTRICT INSPECTORS OF ELECTRICITY
AND GAS

Re: Type Approval Sangamo 25-cycle
Metering Unit, consisting of type
"G" Potential Transformer and
type "LV" Current Transformer,
mounted in steel enclosure.

Dear Sirs:


This is to advise you that the above
named metering unit, manufactured by the Sangamo
Company, Limited, Toronto, Canada, has been ap-
proved by the National Research Council for use
in Canada in the following capacities:

Frequency: 25 cycles;

Potential Transformer Ratio: 575:115;

Current Transformer Ratio: From 5:5 amperes to
500:5 amperes.

Yours truly,

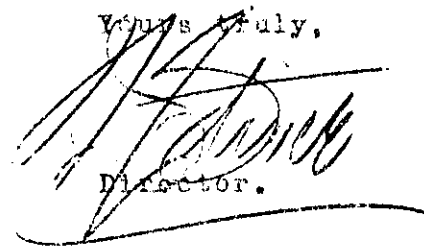

Director.

JLS/mcc