

Electricity

DEPARTMENT OF TRADE AND COMMERCE

ELECTRICITY AND GAS INSPECTION SERVICES

OTTAWA, October 12, 1939.

TO DISTRICT INSPECTORS OF
ELECTRICITY AND GAS.

Re: Approval Sangamo Type "HG" Maximum
Demand Attachment with Test Dial

Dear Sirs:

This is to advise you that the type "HG" maximum demand attachment with test dial, manufactured by the Sangamo Electric Company, Springfield, Illinois, U.S.A., and sold in Canada by Sangamo Company, Limited, Toronto, Canada, has been approved by the National Research Council for use in Canada on the following types of meters and in the capacities listed below:


Sangamo type "HC" watt-hour meters of all classes;
Sangamo type "S3" two and three element vertical
polyphase meters;
Sangamo type "CFA" meters of all classes.

Voltages: 115, 230, 460, 575;
Time Interval: 15, 30 and 60 minutes;
Cycles: 25, 50 and 60.

The Sangamo type "HG" maximum demand attachment without test dial was approved for use on meters of such capacity that a test dial was not required in October, 1935. (See Circular N.R.C. 79).

There is also a further change in the type "CFA" meter which is approved. This change consists of making the edge of the base without any indentations and also in the elimination of rivets for the large seal clip. This new style base will be used on the type "CFA" meter in the future.

Yours truly.

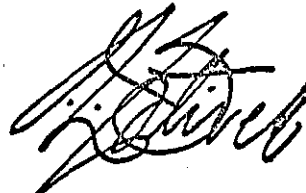

J. L. Stiver,
Director.