

TRADE AND COMMERCE  
CANADA

SD-EA.123

## STANDARDS DIVISION

OTTAWA, September 21, 1953.

TYPE APPROVALCANADIAN GENERAL ELECTRIC  
TYPE "KF58" CURRENT TRANSFORMER


The apparatus specified and illustrated herein has been duly approved by the Standards Division under the provisions of The Electricity Inspection Act, Chapter 22, 1928, as amended, and may be admitted to verification in Canada.


Apparatus Approved: Type "KF58" Current Transformer, manufactured by the Canadian General Electric Company Limited, Toronto, Ontario.


## Rating of Apparatus:

Primary Current .....	5, 10, 12.5, 15, 20, 25, 30, 40, 50, 60, 80, 100, 125, 150, 200, 250, 300, 400, 500, 600, 800 amperes
Secondary Current .....	5 amperes
Metering Burden .....	50 VA at 0.5 p.f.
Rated Primary Voltage .....	15 KV
Frequency .....	25/125 cycles
Style .....	Dry Indoor

Description: These transformers are of the dry indoor type. The primary is wound on top of the secondary and the whole is mounted on one side of a rectangular laminated core. The secondary leads are connected to a terminal block which is mounted on the core, as shown in the illustration. No secondary shorting device is provided.

  
R. W. MacLean,  
Director,  
Standards Division.

  
E. F. Power,  
Assistant Director (E&G),  
Standards Division.

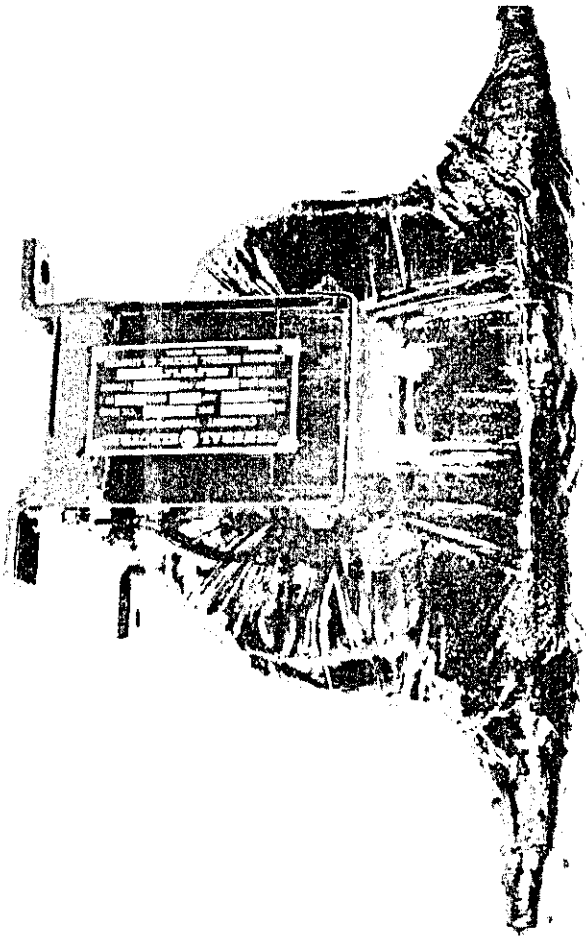

CANADIAN GENERAL ELECTRIC  
TYPE "CF58" CURRENT TRANSFORMER

SD-EA.123