

TRADE AND COMMERCE

STANDARDS DIVISION

OTTAWA, October 3, 1955.

TYPE APPROVAL

CANADIAN GENERAL ELECTRIC TIPE "CT-O" CURRENT TRANSFORMER

The apparatus specified and illustrated herein has been duly approved by the Standards Division under the provisions of the Electricity Inspection act, Chapter 94, R.S. 1952, and may be admitted to verification in Canada.

Apparatus Approved: Type "CT-0" Current Transformer, manufactured by the Canadian General Electric Company Limited, Toronto, Ontario.

Rating of Apparatus:

Primary Current 400 saperes Secondary Current 5 amperes Accuracy Class ASA 0.3B0.2 Rated Voltage 600 volts Wire 2 Phase 1 Frequency 25-60 cycles Style Dry Indoor

Description: These current transformers are designed for indoor service and are of wound secondary construction with primary window opening or bar and single 5-sapere secondary. The manufacturer specifies high grade silicon steel used in the core. The entire core and coil assembly is impregnated with, and moulded in, a thermosetting plastic material of high mechanical and electrical strength. Secondary terminals are solderless connectors.

E. F. Fower

E. F. Power,

Assistant Director (E&G), Standards Division.


Director,

Standards Division.

	· ·			
			· mage	
			المستدر	

CANADIAN GENERAL ELECTRIC
TYPE "CT-O" CURRENT TRANSFORMER



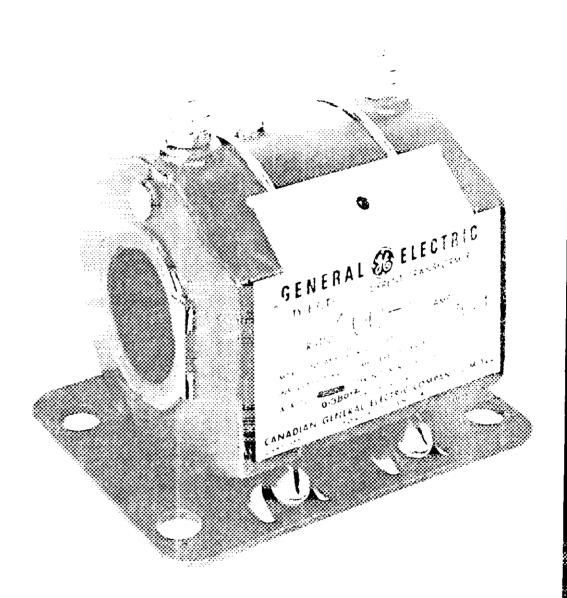

			کرید.
			and the