



TRADE AND COMMERCE
CANADA

SD-EA.327

STANDARDS DIVISION

OTTAWA..... December 30, 1957..

TYPE APPROVALSANGAMO TYPE "NBA" POLYPHASE WATTHOUR METERS

The apparatus specified and illustrated herein has been duly approved by the Standards Division under the provisions of the Electricity Inspection Act, Chapter 94, R.S. 1952, and may be admitted to verification in Canada.

Apparatus Approved: Type "NBA" Polyphase Watthour Meters, manufactured by the Sangamo Company Limited, Leaside, Toronto 17, Ontario.

Rating of Apparatus:


Nominal Amperes	10, 15, 25, 50
Maximum Amperes	40, 60, 75, 100
Voltages	115, 230, 460, 575
	or 120, 240, 480, 600
Wire	3
Elements	2
Frequency	60 cycles


Description: These meters are identical to the type "NBAP" approved under Circulars SD-EA.133, December 11, 1953, SD-EA.147, April 5, 1954 and SD-EA.177, February 10, 1955, except that a conventional "A" terminal block has been substituted for the "AP" block.

E. F. Power,
Assistant Director (E&G),
Standards Division.

R. W. MacLean,
Director,
Standards Division.

Ref: A-717



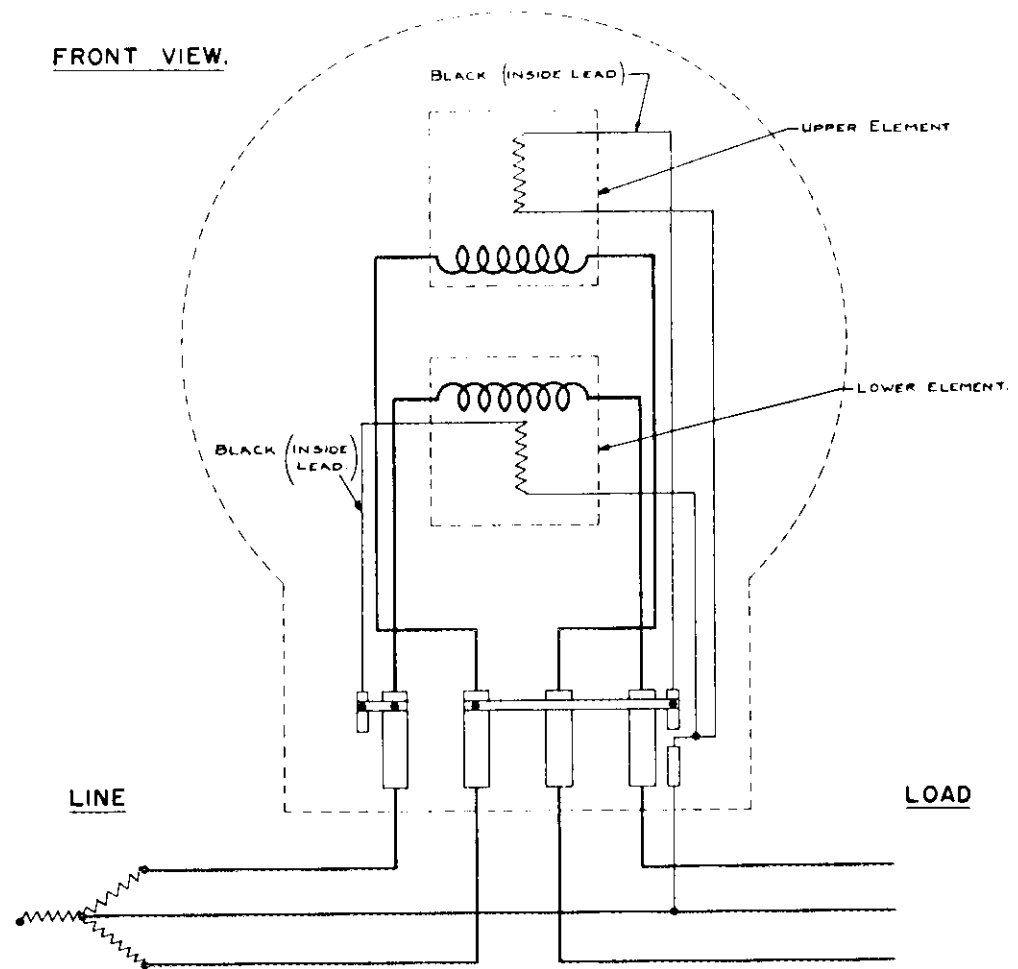

INTERNAL & EXTERNAL WIRING FOR TYPE
NBA 2 ELEMENT 5 TERMINAL NETWORK METER.

