



TRADE AND COMMERCE
CANADA

STANDARDS DIVISION

OTTAWA, November 14, 1958.

TYPE APPROVALSANGAMO TYPE "MV-6" CURRENT TRANSFORMER

The apparatus specified and illustrated herein has been duly approved by the Standards Division under the provisions of the Electricity Inspection Act, Chapter 94, R.S. 1952, and may be admitted to verification in Canada.

Apparatus Approved: Type "MV-6" Current Transformer, manufactured by the Sangamo Company Limited, Leaside, Toronto 17, Ontario.

Rating of Apparatus:

Primary Currents 5, 10, 15, 20, 25, 30, 40, 50, 75, 100, 150,
200, 300, 400, 600 and 800 amperes

Secondary Current 5 amperes

Voltage Rating 0.6 KV

Accuracy Class:

(at 60 cycles).. 0.3F0.1, 0.3F0.2^{*}, 0.6B0.5

(at 25 cycles).. 0.6B0.1, 0.6B0.2


Frequency 25/60 cycles

Style Dry Indoor

Wire 2

* stamped on nameplate.

Description: The type "MV-6" current transformer is designed for indoor service, primarily for metering purposes. It is interchangeable with, and will supersede, the type "LV" transformer. The entire coil and core assembly is moulded in an epoxy resin.

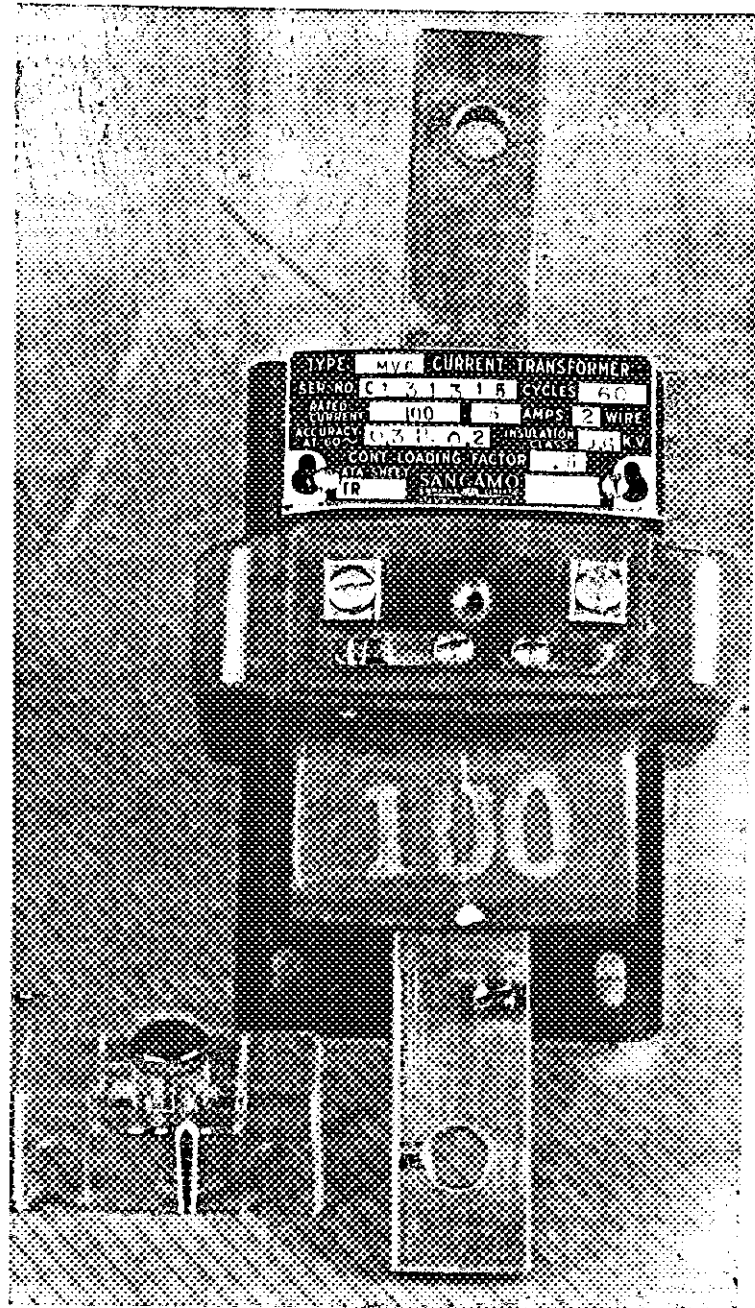

R. W. MacLean,
Director,
Standards Division.

Ref: A-756



E. F. Power,
Assistant Director (E&G),
Standards Division.

SANGAMO TYPE "MV-6" CURRENT TRANSFORMER



100

100

100