



LANDIS & GYR TYPE "KYA1" TIME SWITCH

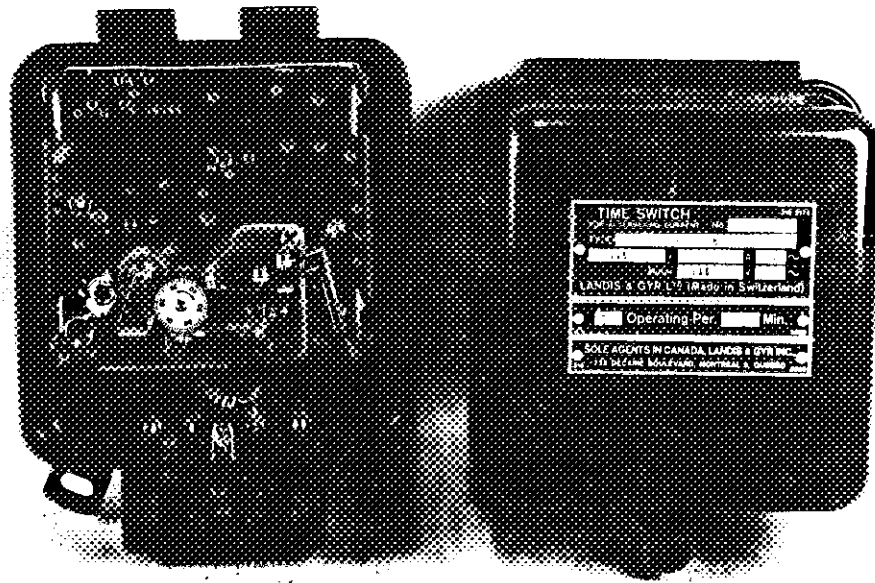



Description (cont'd)

The incorporation of any of the approved attachments in a time switch will be indicated on the cover as a suffix to the type designation, along with the period of operation.

The terminals will be identified by a paper diagram pasted inside the terminal cover.

E. W. MacLean
E. W. MacLean,
Director,
Standards Branch.

W. J. Fraser
(for) E. F. Power,
Chief, Electricity & Gas Division,
Standards Branch.

Ref: A818B

