



Consumer and
Corporate Affairs

Consommation et
corporations

Standards

Normes

**NOTICE OF APPROVAL
AVIS D'APPROBATION**

T - 13 - 3

Ottawa, May 5, 1976

**FERRANTI-PACKARD TYPES "MG-25", "MG-35",
"MG-46" AND "MG-69" VOLTAGE TRANSFORMERS**


This Notice of Approval constitutes an addition to T-13-2.


Approval is hereby extended to newly designed Types "MG-25", "MG-35", "MG-46" and "MG-69" which are built with a single primary coil like that of Types "MG-115" and "MG-138" approved under T-78, thus all classes will have the same accuracy rating, namely 0.3 W,X,Y,Z,ZZ; 0.3Z - 0.3Z. The total burden on the two secondary windings must not exceed ZZ.

The voltage ratings given in T-13-2 for the Types "MG-25", "MG-35", "MG-46" and "MG-69" also apply to the newly designed transformers.


Approval granted to:

Ferranti-Packard Limited,
St. Catharines, Ontario.

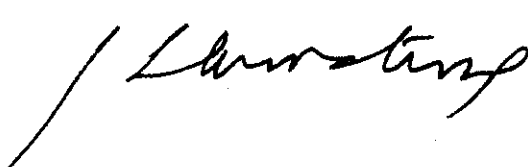
J. L. Armstrong, P.Eng.,
Chief, Standards Laboratory,


D. L. Smith, P.Eng.,
Chief, Electricity and Gas Division,
Metrology and Laboratory Services

Ref. G 6565-F2-35

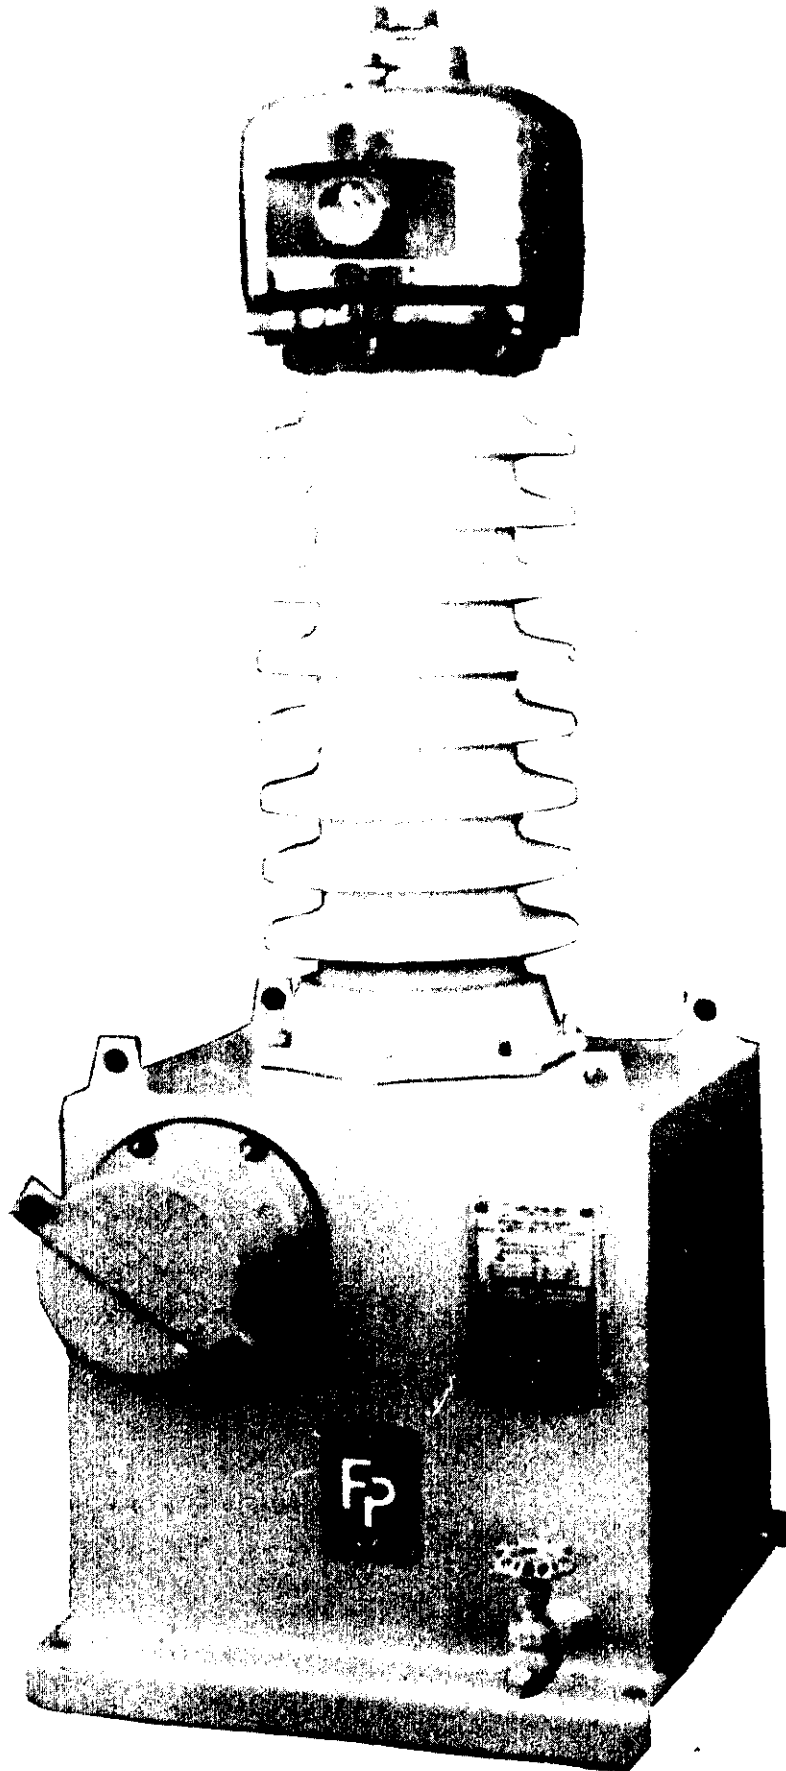

Type MG-69