



DEPARTMENT OF TRADE AND COMMERCE
STANDARDS BRANCH

T-30

OTTAWA September 19th 67

NOTICE OF APPROVAL

FOR

CANADIAN WESTINGHOUSE TYPE "KT-.6A" CURRENT TRANSFORMERS

	<u>Apparatus</u>
Primary Current	5, 10, 15, 20, 25, 30, 40, 50, 75, 100, 150, 200, 250, 300, 400, 500, 600, 800, 1000 and 1200 amperes
Secondary Current	5 amperes
Accuracy Rating 600 and 1200 amp ratings	0.3B0.1, B0.2, B0.5, B0.9, B(2x0.9)*, B1.0
All others	0.3B0.1, B0.2, B0.5, B0.9#; 0.6B(2x0.9)#, B1.0.
Voltage Rating	600 volts
Frequency	60 hz
Wire	2
Rating Factor	
1200 amperes	1.1
600 and 1000 amperes	1.33
All others	1.5
Style	Moulded, indoor

* 0.3B(2x0.9) marked on the nameplate


0.3B0.9, 0.6B(2x0.9) marked on the nameplate

Description

The type "KT-.6A" current transformers are similar in appearance to the type "KT.6" which they supersede and which received approval under S-EA.496(amended), and S-EA.518.

They differ in that they have an improved accuracy and are approved for use on 60 hz only.


CANADIAN WESTINGHOUSE TYPE "KT-.6A" CURRENT TRANSFORMERS

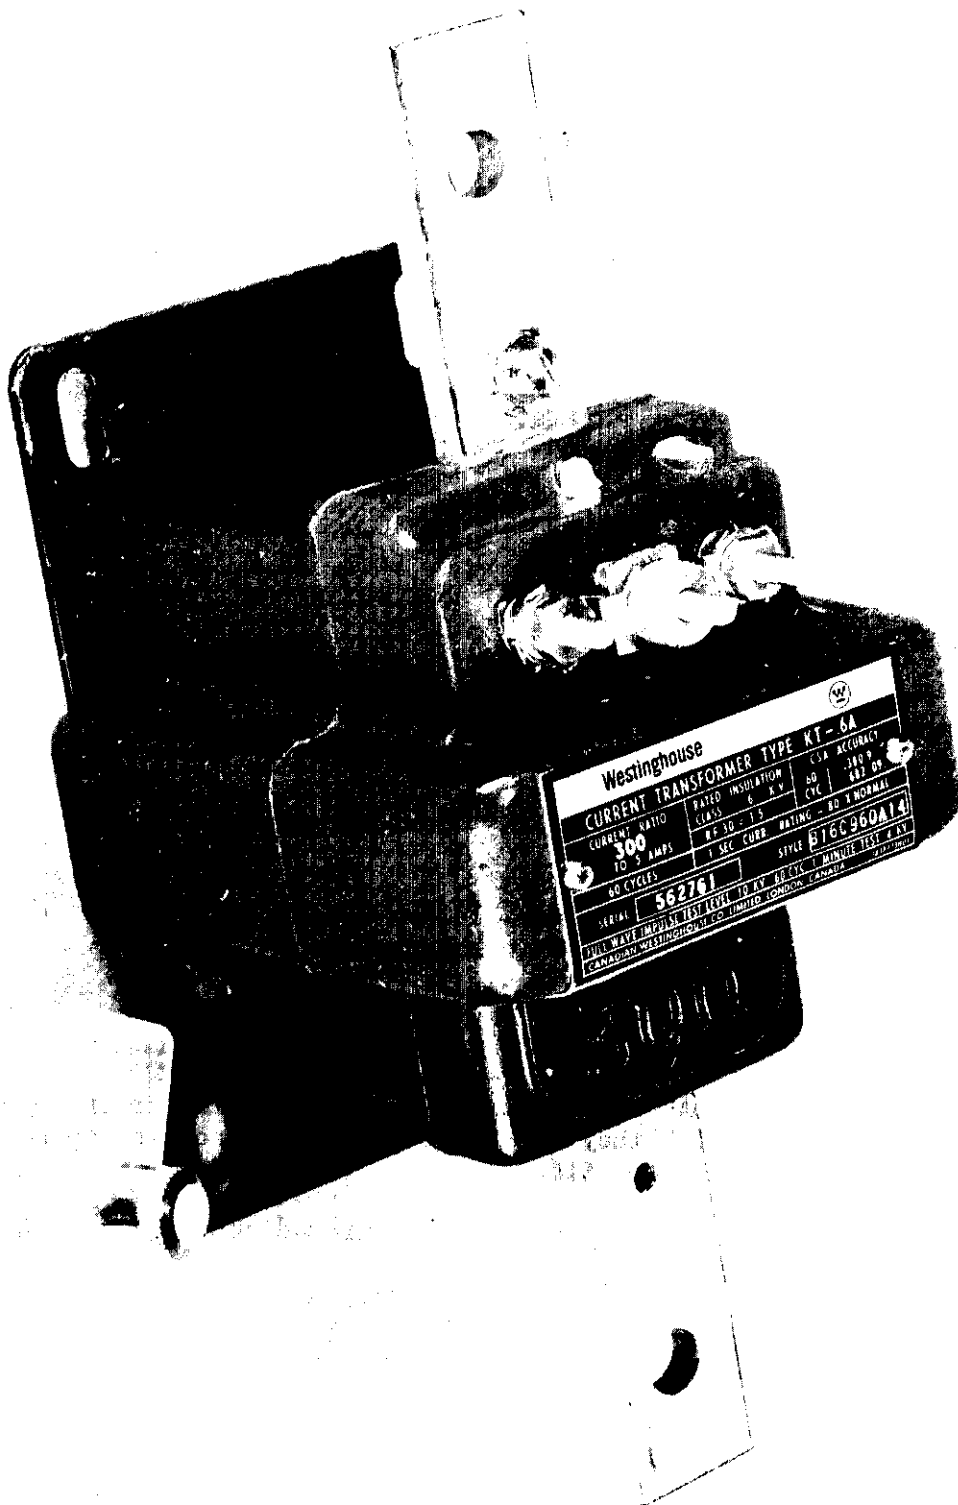

All ratings have the same finger-operated secondary short-circuiting device, and the primary current rating is moulded into the body in addition to its being marked on the nameplate.

Approval granted to: Canadian Westinghouse Company Limited,
London, Ontario.


(for) Chief, Standards Laboratory,
Standards Branch.


W.J.S. Fraser,
Chief, Electricity & Gas Division,
Standards Branch.

Ref. SL-100-900N