



Department of consumer and corporate affairs / Ministère de la consommation et des corporations



STANDARDS BRANCH - DIRECTION DES NORMES

NOTICE OF APPROVAL

T-49

OTTAWA November 7, 1969

SANGAMO TYPE "ME" FORM "150" VOLTAGE TRANSFORMERS

Apparatus

Primary Voltages	14400, 12000, 8400, 7200 volts
Secondary Voltage	120 volts
Accuracy rating at 60hz	0.3WXYZ;* 1.2ZZ
Frequency	60hz
Voltage insulation class	15kv
Thermal rating	1750 VA
Style	Indoor, moulded

* The nameplates are marked 0.3Z





Description

The Type "ME" Form "150" voltage transformers are designed for indoor service, for operating meters, relays and instruments. The "Form 150" indicates the voltage class.

These transformers are available without fuses, with one fuse for line to ground (or neutral) application and with two fuses for use for line-to-line application.

The core is wound type of directional grain steel and the entire transformer is vacuum cast in epoxy resin. All terminals are moulded as an integral part of the transformer, those for the line being supplied with pressure connectors.

SANGAMO TYPE "ME" FORM "150" VOLTAGE TRANSFORMERS

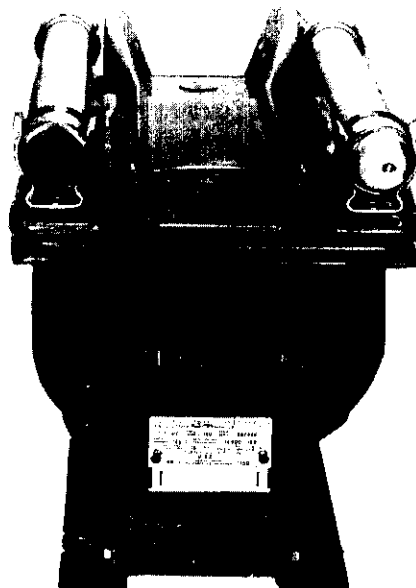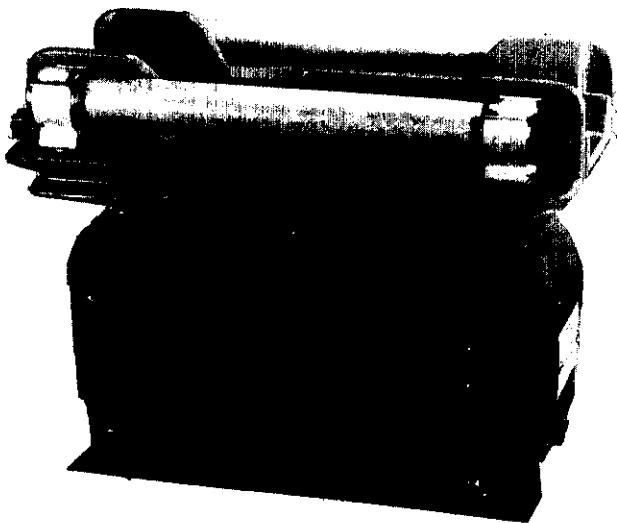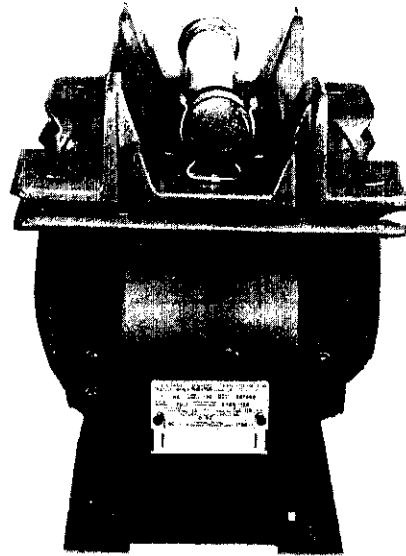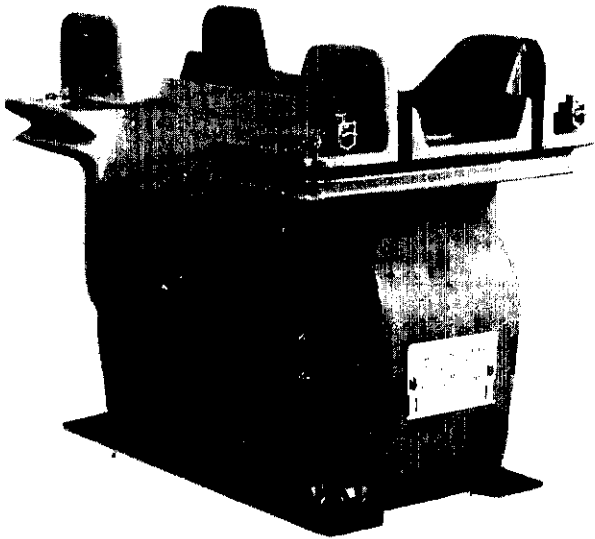


Polarity is subtractive and is indicated by "HI" and "XI" moulded in the epoxy adjacent to the respective terminals.


Production nameplates may differ slightly from those illustrated which are photocopies.

Approval granted to:

Sangamo Company Limited,
Leaside,
Toronto 17, Ontario.

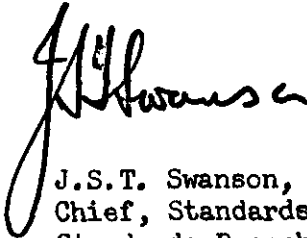

J.S.T. Swanson, P. Eng.,
Chief, Standards Laboratory,
Standards Branch.



G.E. Anderson,
Assistant Director & Chief Engineer

(for) W.J.S. Fraser,
Chief, Electricity and Gas Division,
Standards Branch.

Ref: SL-100-77 (J)
SE-85-6-10