



Department of consumer and corporate affairs / Ministère de la consommation et des corporations



STANDARDS BRANCH - DIRECTION DES NORMES

**NOTICE OF APPROVAL
AVIS D'APPROBATION**


T-94

OTTAWA March 8, 1976


**ELECTROMAGNETIC INDUSTRIES CURRENT TRANSFORMERS
MODELS 200, 201, 202 and 203**

<u>Model</u>	<u>Current Ratings</u>	<u>Accuracy Class</u>	<u>Rating Factor</u>
200	100:5, 150:5	0.6B0.1	1.5
	200:5	0.3B0.2, 0.6B0.5	1.5
	300:5	0.3B1.0, 0.6B2.0	1.5
	400:5, 600:5	0.3B2.0	1.5
201	150:5	0.6B0.1	1.5
	200:5	0.3B0.1, 0.6B0.2	1.5
	300:5	0.3B0.5, 0.6B1.0	1.5
	400:5	0.3B1.0, 0.6B2.0	1.5
	600:5, 800:5	0.3B2.0	1.5
202	200:5	0.6B0.1	1.5
	300:5	0.3B0.2, 0.6B0.5	1.5
	400:5	0.3B0.5, 0.6B1.0	1.5
	600:5, 800:5	0.3B2.0	1.5
203	300:5	0.6B0.1	1.5
	400:5	0.3B0.1, 0.6B0.2	1.5
	600:5	0.3B0.2, 0.6B0.5	1.5
	800:5, 1,000:5	0.3B1.0, 0.6B2.0	1.5
	1200:5	0.3B2.0	1.5
	1500:5	0.3B2.0	1.33
	2000:5	0.3B2.0	1.33
	3000:5, 4000:5	0.3B2.0	1.0

Insulation Class 600 volts

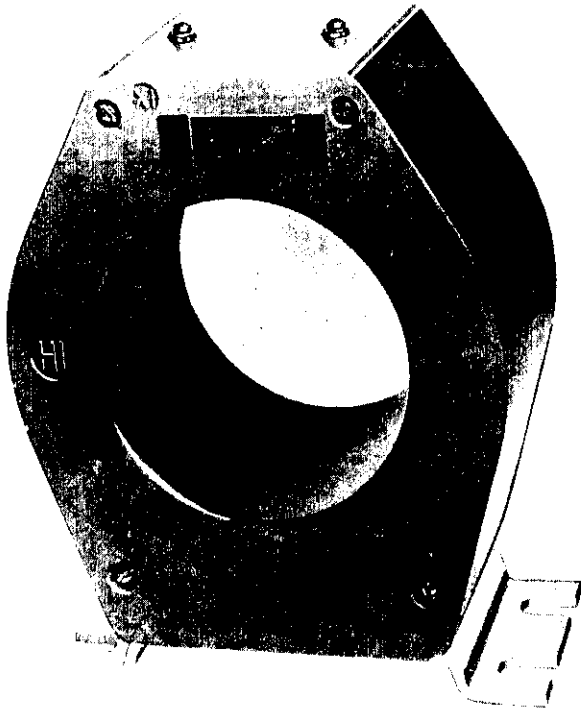

Model 203

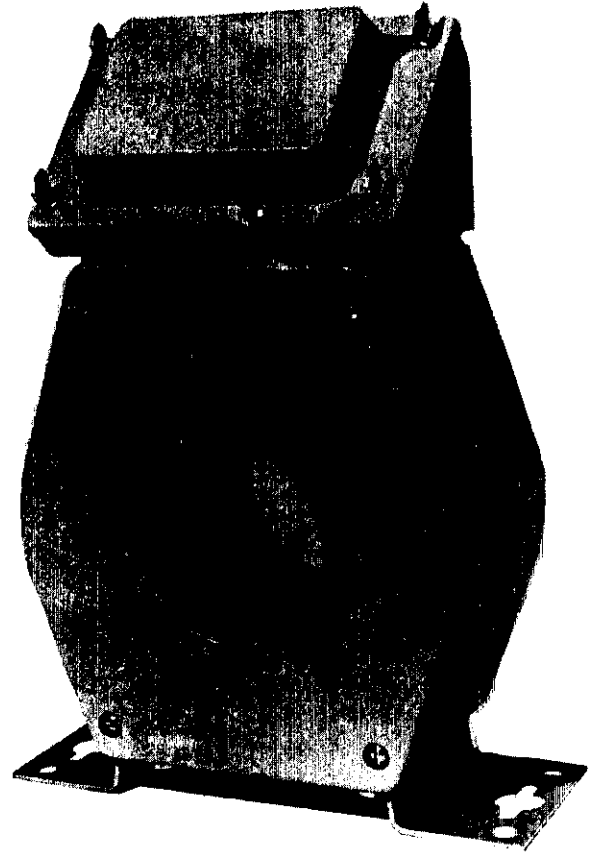

Model 200
with Conduit Box

Description

These transformers are window types, the essential difference between models being the window size which varies from 2½" for the model 200 to 5¼" for model 203.

The case is moulded reinforced plastic. The transformers may be supplied in either indoor or outdoor versions, the latter being equipped with either a terminal cover or conduit box.

The primary entrance side is marked H₁. There is no short-circuiting device.

Approval granted to:

Electromagnetic Industries Inc.
P.O. Box 6440,
Clearwater, Florida 33518 .



J.L. Armstrong,
Chief, Standards Laboratory,
Metrology and Laboratory Services.



D.L. Smith,
Chief, Electricity & Gas Division
Metrology and Laboratory Services.

Ref: GL 1145-57/E80-155