



**NOTICE OF APPROVAL
AVIS D'APPROBATION**

T-108-1

Ottawa, June 2, 1976

H. K. PORTER TYPE MO-25 THREE PHASE THREE WIRE
AND THREE PHASE FOUR WIRE METERING OUTFITS

This Notice constitutes an addition to Notice of Approval T-108 which remains in effect.

Voltage Transformers:

	<u>3Ø 3 Wire</u>	<u>3Ø 4 Wire</u>
Type	"TLM-25"	"TNM-25"
Voltage Ratios	24000-120 volts	16800-120 volts 16100-115 volts
Accuracy rating at 60 Hz	0.3 W,X,Y,Z,ZZ	

Current Transformers:


Type	COM-25
Primary Current Ratings	10/5, 20/10, 30/15, 50/25, 100/50, 150/75, 200/100, 400/200, 600/300, 800/400 and 1200/600 amperes
Secondary Current	5 amperes
Accuracy rating at 60 Hz	
High Ratio	0.3 B-1.0 0.6 B-2.0
Low Ratio	0.3 B-0.9 0.6 B-1.8
R.F.(rating factor)	1.5

Ampere turns rating	
800-5 amperes	1600 AT
400-5 amperes	800 AT
All other high ratios	1200 AT
All other low ratios	600 AT
Frequency	60 Hz
Style	Oil insulated, outdoor

Description

The Type "MO-25" fits the description given for the Type "MO-35" in T-108.

Approval granted to: H. K. Porter Company (Canada) Ltd.,
Woodstock, Ontario.

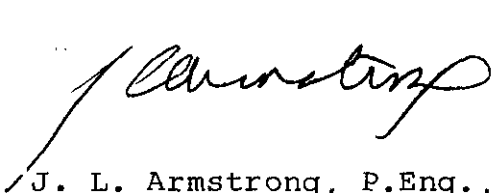

J. L. Armstrong, P.Eng.,
Chief, Standards Laboratory,
Metrology and Laboratory Services



D. L. Smith, P.Eng.,
Chief, Electricity and Gas Division,

Ref: G-6565-P113-33