



Consumer and
Corporate Affairs

Consommation et
corporations

Legal Metrology

Métriologie Légale

T-131

Approval No. d'approbation

Ottawa, December 19, 1980

NOTICE OF APPROVAL – AVIS D'APPROBATION

**SANGAMO TYPES "M10-1501" AND "M10-2501"
CURRENT TRANSFORMERS**

Primary Current: 5, 10, 15, 25, 40, 50, 75, 100, 150,
200, 300, 400, 600, 800, 50/25,
100/50, 200/100, 400/200, 600/300,
and 800/400A.

Secondary Current: 5A

Accuracy Rating @ 60 Hz:

Single Ratio and
High Ratio of Double Ratio 0.3B2.0
Low Ratio of Double Ratio 0.3B0.9

Nominal Voltage Class:

M10-1501 15KV
M10-2501 25KV

Rating Factors:

600 and 600/300 1.33
All Others 1.5

Frequency: 60 Hz

Wire: 2

Style: Moulded, Outdoor

. . . /2

Description

Types M10-1501 and M10-2501 are epoxy moulded transformers comprising a wound primary and a toroidal core upon which the secondary coil is toroidally wound.

The secondary terminals are contained in a die cast aluminum conduit box, with rubber gaskets and a sealable cover-plate.


The secondary terminals are two threaded studs marked $X_1 X_2$ with a shorting link and a ground stud bonded to the transformer core, conduit box and baseplate. For double ratios, three secondary terminals are marked X_1, X_2, X_3 , with a shorting link between X_1, X_3 , as well as a ground terminal.

Approval granted to: Sangamo Company Ltd,
215 Laird Drive,
Toronto, Ontario.
M4G 3X1



D. L. Smith, P. Eng.,
Chief, Electricity and Gas Division,
Legal Metrology Branch.

Ref: G6565-S2-32

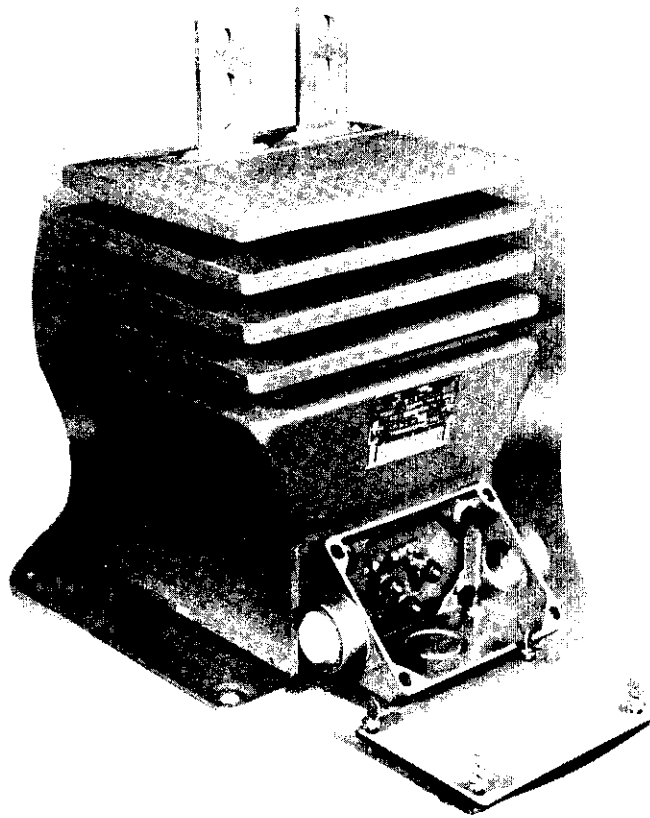

MIO-1501

MIO-2501

